




Controller Model: **Modicon Compact and Modicon 984**

Maple OIT Model: **MAP460D, OIT3600B**

Communication Type: **RS-232 with DE9 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with a Modicon Compact or Modicon 984 PLC.

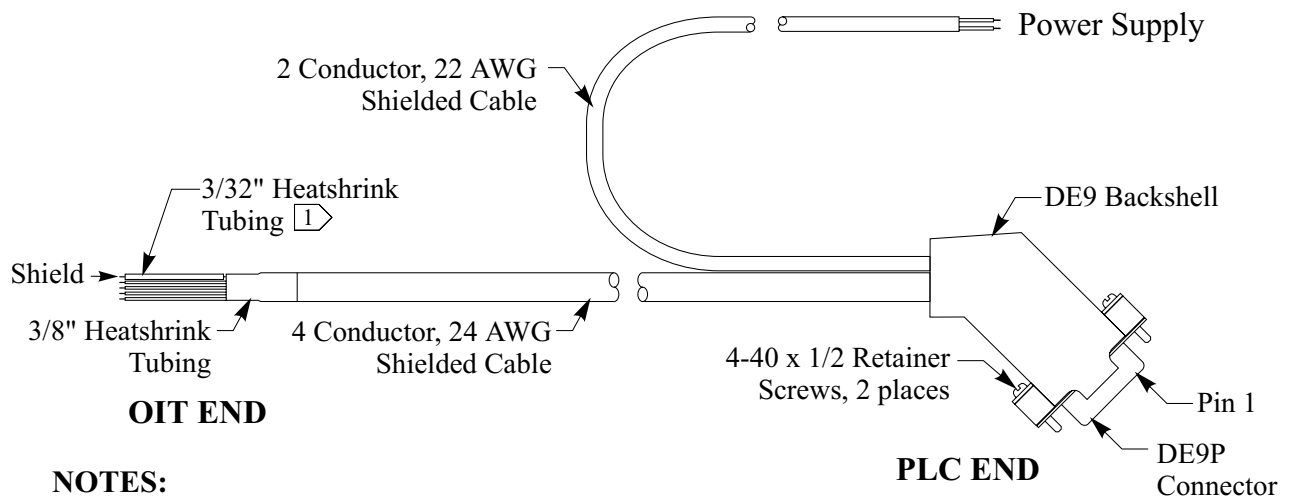

NOTES:

- ① Install heatshrink on shield (bare wire) to avoid shorting to components.

