




Controller Model: **Omron C200H Series**  
 Maple OIT Model: **MAP460D, OIT3600B**  
 Communication Type: **RS-232 with DB25 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Omron C Series PLC. This cable is for communication through a Host Link connection. For the C20K, C28K, C40K, C60K, C200H OR C200H+ models.

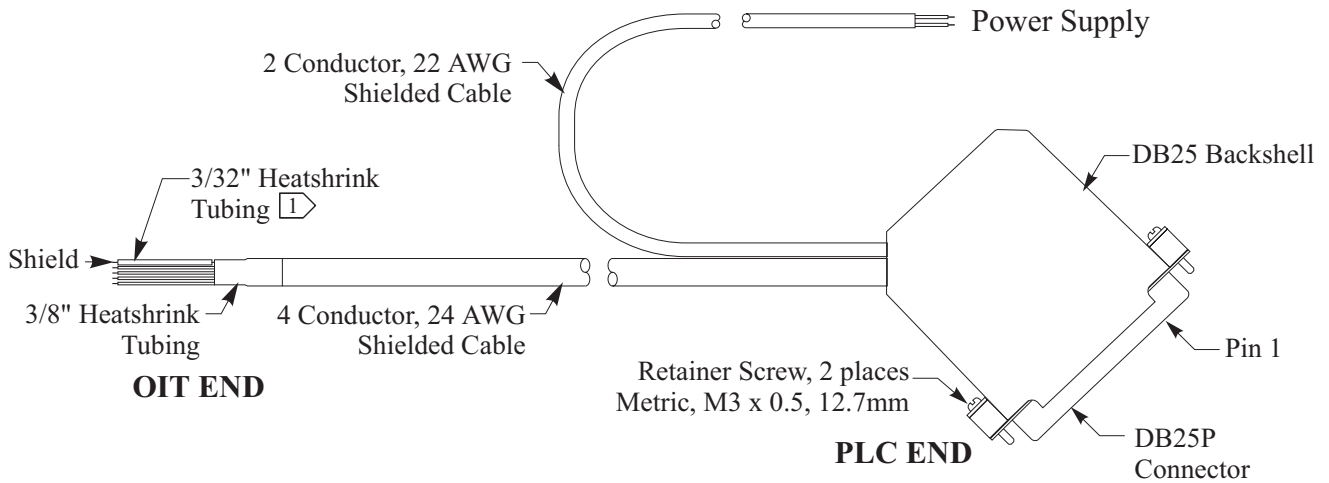

**NOTES:**

- ① Install heatshrink on shield (bare wire) to avoid shorting to components.

