




Controller Model: **Omron C20, C40, C60, & C200H Series**

Maple OIT Model: **OIT3100 and OIT4100 Series**

Communication Type: **RS-232 with DB25 connector at PLC**

Use the wiring diagram and illustration to assemble a communication cable for use with an Omron C Series PLC. This cable is for communication through a Host Link connection. For the C20K, C28K, C40K, C60K, C200H or C200H+ models where a 25-pin DB connector is required.

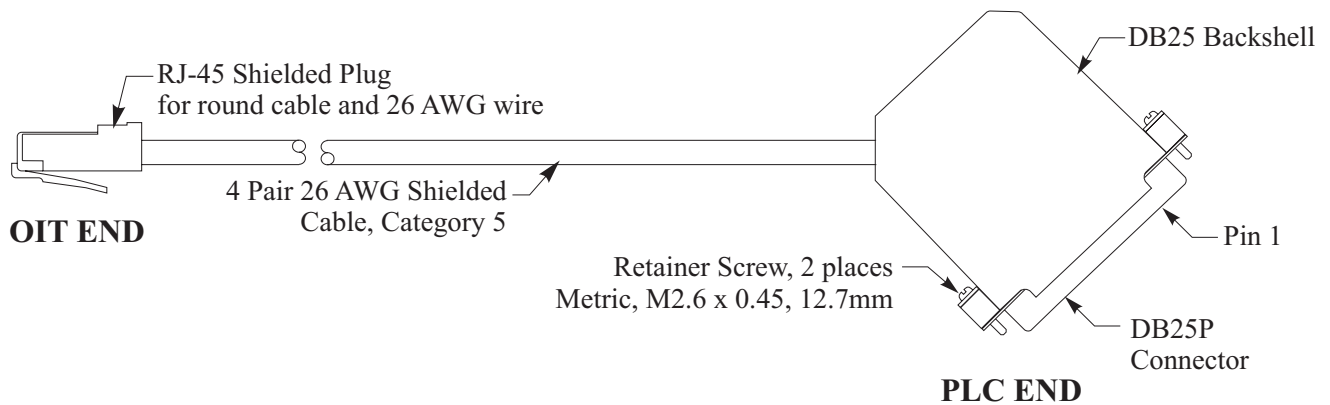

NOTES:

- 1 Install heatshrink on shield (bare wire) to avoid shorting.
- 2 Connect shield wire to the metal housing of the RJ-45 connector.

