




Controller Model: **Allen-Bradley MicroLogix™ 1000, 1200, 1500**

Maple OIT Model: **BLU300 Series**

Communication Type: **RS-232 with 8-pin connector at PLC**

The 8-pin connector for the Allen-Bradley MicroLogix™ 1000, 1200, or 1500 PLC is a special part only available through Allen-Bradley. We recommend that you purchase Maple Systems' Cable (P/N 7445-0040) or purchase a cable from Allen-Bradley. This wiring diagram shows how Maple Systems' Cable (P/N 7445-0040) is assembled.

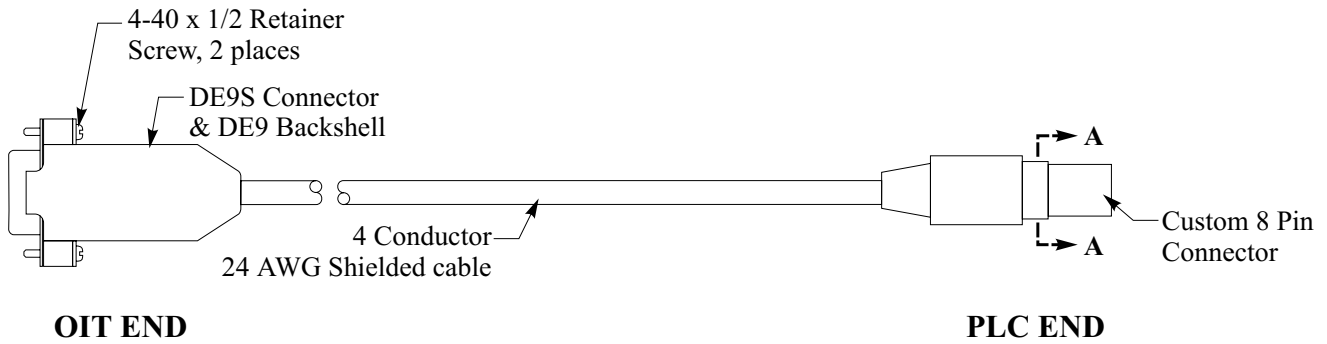

NOTES:

- 1 ▷ Shield wire must be terminated to connector metal shell.
- 2 ▷ Solder shield wire to the DE9S connector metal shell. Install heatshrink tubing over the shield wire to avoid shorting.

