




Controller Model: **Industrial Control Links ICL Series, SIXNET SIXTRAK Gateway and VersaTrak RTU Controllers**

Maple OIT Model: **BLU300 Series**

Communication Type: **RS-232 with DE9 connector at Controller**

Use the wiring diagram and illustration to assemble a communication cable for use with an Industrial Control Links ICL Series controller, and SIXNET SIXTRAK Gateway and VersaTrak RTU controllers.

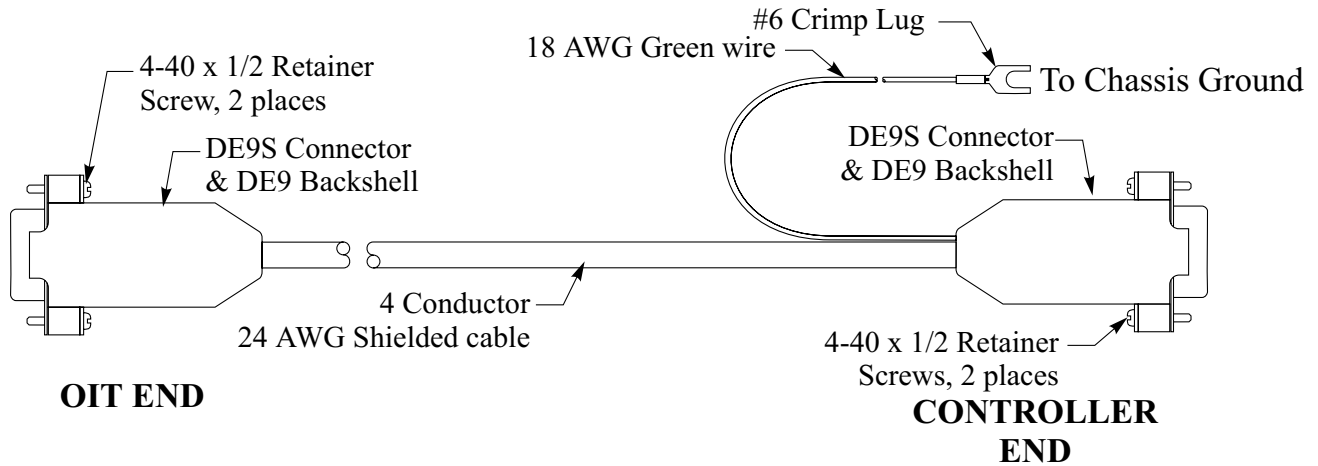

NOTES:

- 1 ➤ Twist together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink to avoid shorting.
- 2 ➤ Solder shield wire to the DE9S connector metal shell. Install heatshrink tubing over the shield wire to avoid shorting.

