




Controller Model: **Motorola RTU**
 Maple OIT Model: **BLU300 Series**
 Communication Type: **RS-232 with RJ-45 at Controller**

Use the wiring diagram and illustration to assemble a communication cable for use with a Motorola RTU MOSCAD or MOSCAD Lite controller.

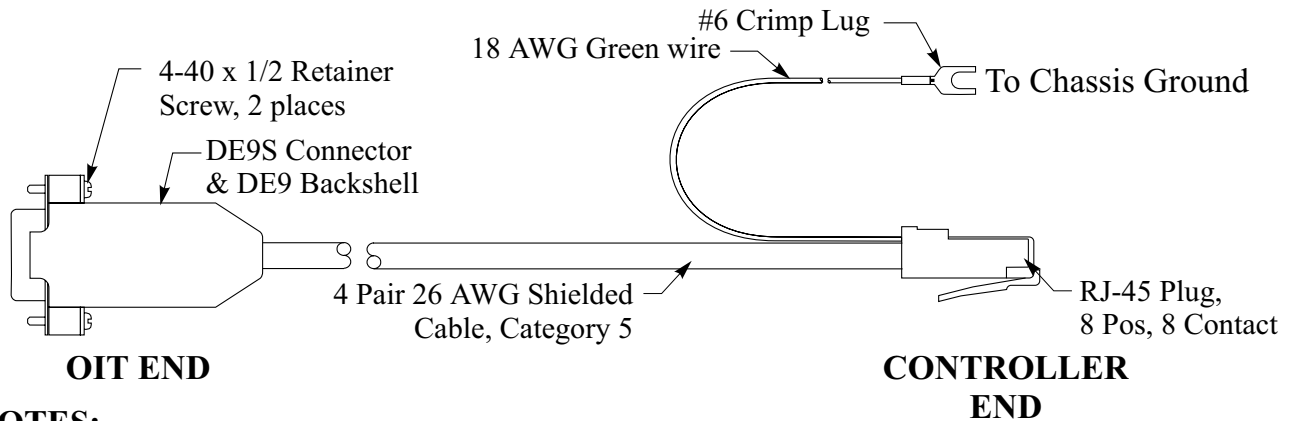

NOTES:

- 1) Twist together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink to avoid shorting.
- 2) Numbering for the Controller end is shown with both conventional RJ-45 numbering and with Motorola numbering. Motorola numbering is reversed from conventional.

