




Controller Model: **Motorola RTU (RS485-2W)**

Maple OIT Model: **BLU300 Series**

Communication Type: **RS-485 with RJ-11 connector at Controller**

Use the wiring diagram and illustration to assemble a communication cable for use with a Motorola RTU MOSCAD or MOSCAD Lite controller.

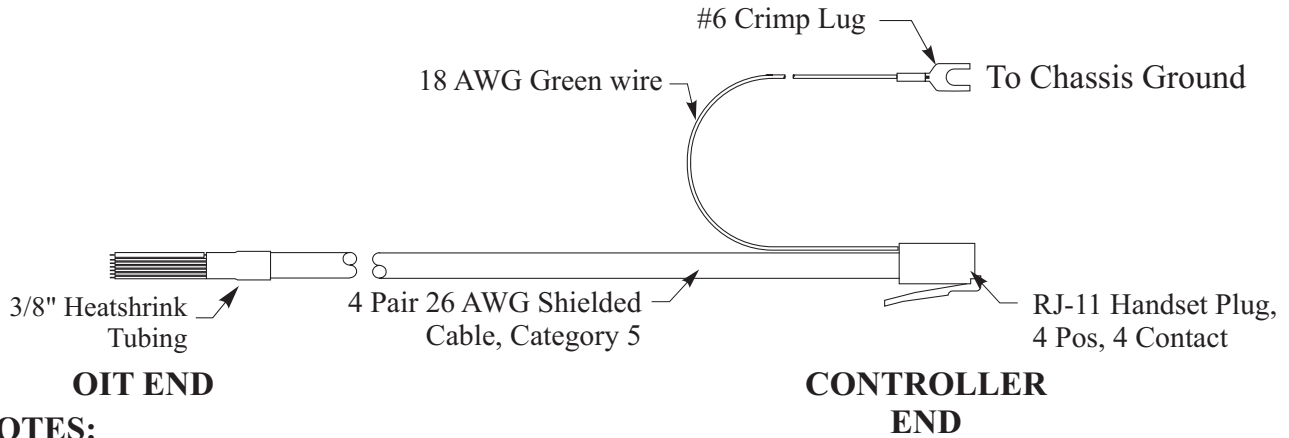

NOTES:

- 1 Twisting together 18 AWG green wire and shield wire. Solder wires and insulate with heatshrink to avoid shorting.
- 2 Numbering for the PLC end is shown with both conventional Handset numbering and with Motorola numbering. Motorola numbering is reversed from conventional.

