




Controller Model: **GE Fanuc VersaMax Micro**
 Maple OIT Model: **BLU300 Series**
 Communication Type: **RS-232 with RJ-45 at PLC**

Use this wiring diagram and illustration to assemble a communication cable for a GE Fanuc VersaMax Micro PLC.

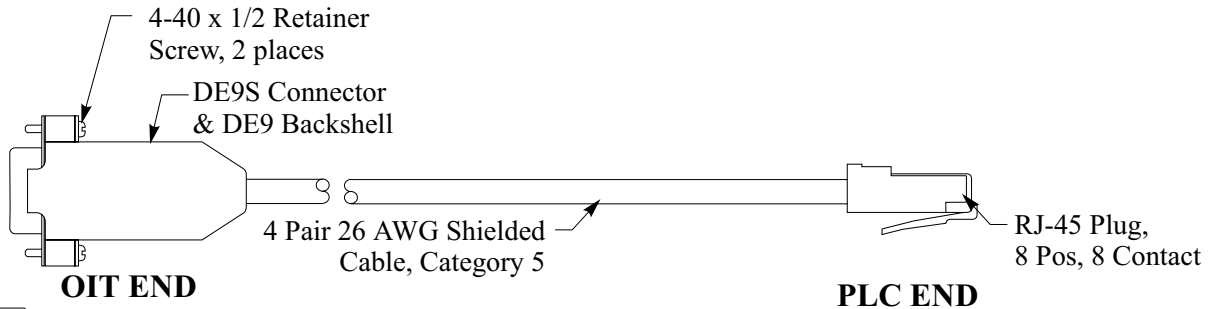

- 1 Connect shield wire to the metal housing of the RJ-45 connectors.
- 2 Numbering for the controller end is shown with both conventional RJ-45 numbering and with GE Fanuc numbering. GE Fanuc numbering is reversed from conventional.

