

CABLE ASSEMBLY INSTRUCTION

Maple Model(s)

HMI5000 Series (COM1)
HMI600 Series

PLC or Controller

Panasonic Aromat FP1

Communication Type



RS-485 4-wire with 8 Pin
Connector at PLC



Summary

Use the wiring diagram and illustration to assemble a communication cable for use with a Panasonic Aromat FP1 Controller.

Drawing and Schematic

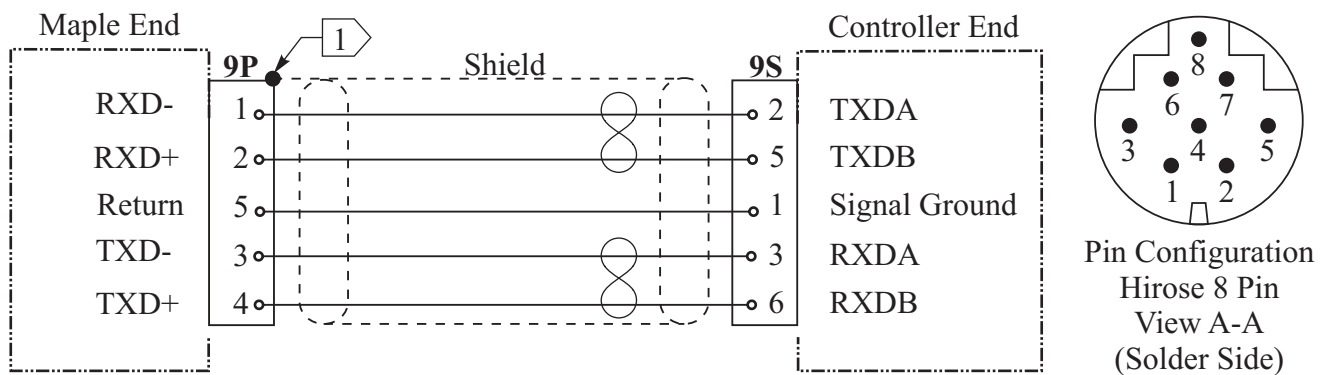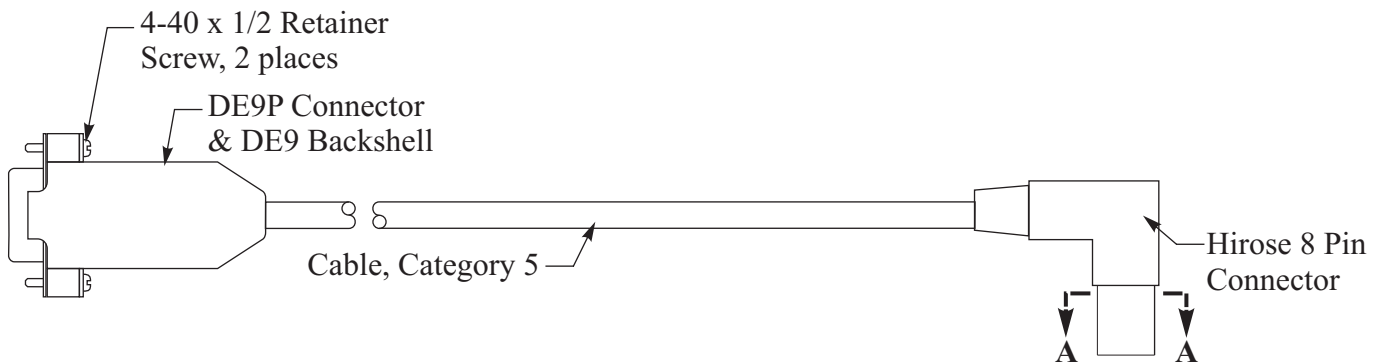

Notes

- 1 Shield wire must be terminated to connector metal shell.